


UTILITY REQUIREMENT NOTES:

- 1. FLUSH LINES CLEAR BEFORE CONNECTING TO STATION.
- 2. PLUMBER TO PROVIDE SHUT-OFF VALVES FOR WATER CONNECTIONS.
- 3. SHOWER SHALL PROVIDE 20 GALLONS (75.8 LITERS) OF WATER PER MINUTE FOR 15 MINUTES.
- 4. UNIT MUST DELIVER AT LEAST 0.4 GPM (1.5 LITERS) FOR EYEWASH FOR 15 MINUTES.
- 5. WATER SUPPLY TO BE CAPABLE OF DELIVERING REQUIRED FLOW WHEN ALL COMPONENTS ARE OPERATED SIMULTANEOUSLY.
- 6. WATER DELIVERED BY SAFETY STATION SHALL BE LUKEWARM (60-90 °F)

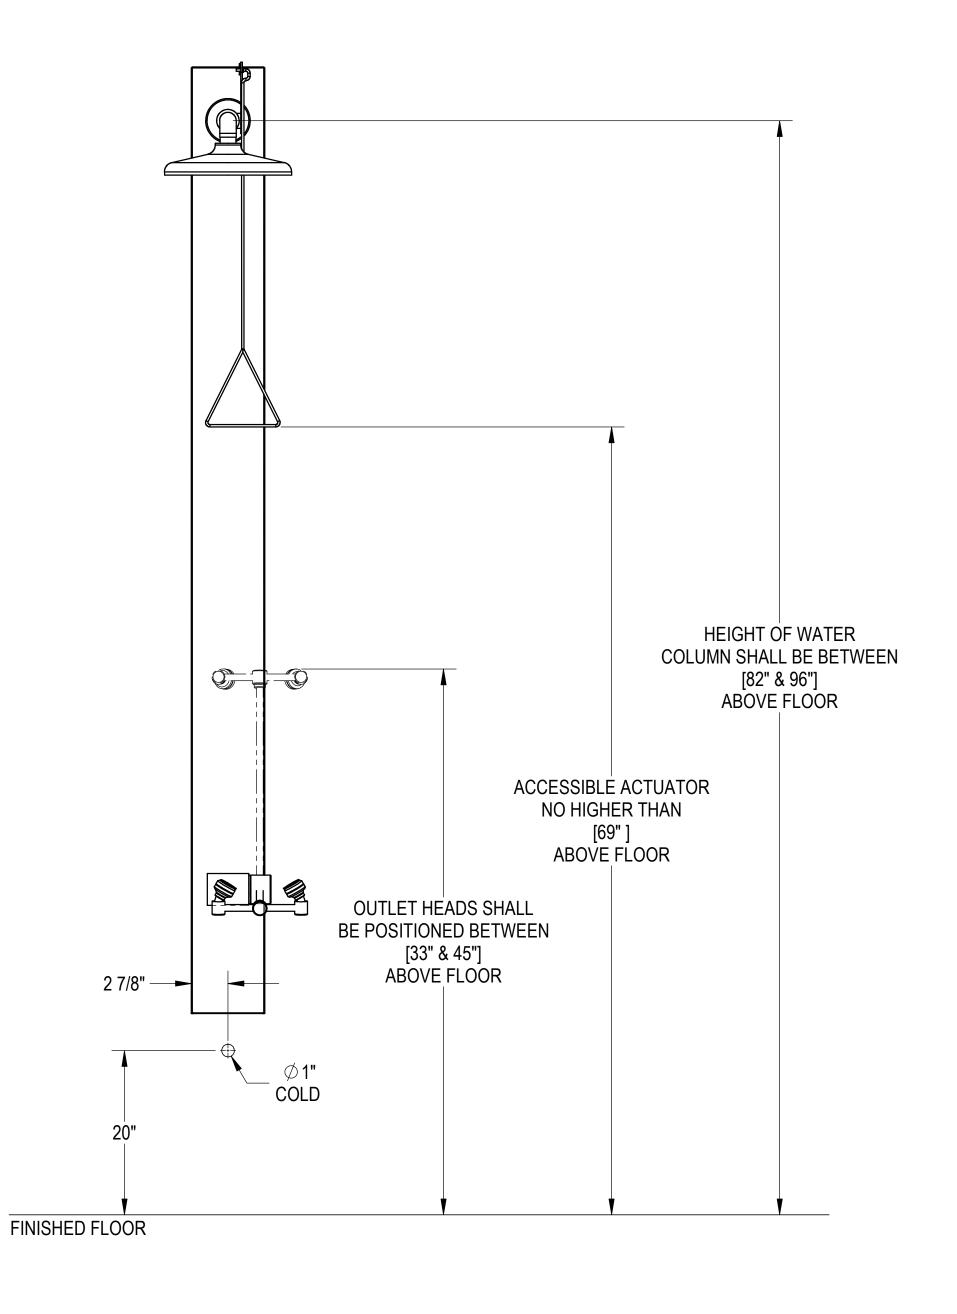

CUSTOMER PROJECT	APPROVAL	APPROVAL		PROPRIETARY THIS DOCUMENT AND THE DATE DISCLOSED HEREIN AND HEREWITH IS NOT TO BE REPRODUCED, USED, OR OTHERWISE DISCLOSED IN WHOLE OR IN PART TO ANYONE WITHOUT WRITTEN AUTHORIZATION FROM MORTECH MFG.			GROUP ELEVATING PATHOLOGY MANUFACTURING MODEL LW399				
			DO NOT SCALE DRAWING	APPROVALS	DATE		WALL-MOUNTED SHOWER & EYEWASH ROUGH-IN				
	SIGNATURE	DATE	MATERIAL _	DRAWN BY GABRIEL G.	02/19/16	SIZE DWG NO.		IIN	RE	EV.	
			FINISH	CHECKED BY		С	LW399			X03	
			-	APPROVED BY		SCALE 1:8	NEXT ASSY.	SHEET	2 OF	2	